


CURB DETAIL FOR ROOFTOP AIR HANDLING UNITS



NOTE:

1. THE CURB, WOOD NAILER, AND INSULATION SEAL STRIP ARE TO BE SUPPLIED BY THE CURB MANUFACTURER. THE NOMINAL 14 INCH CURB HEIGHT IS EFFECTIVE AS OF JANUARY 1, 1981.

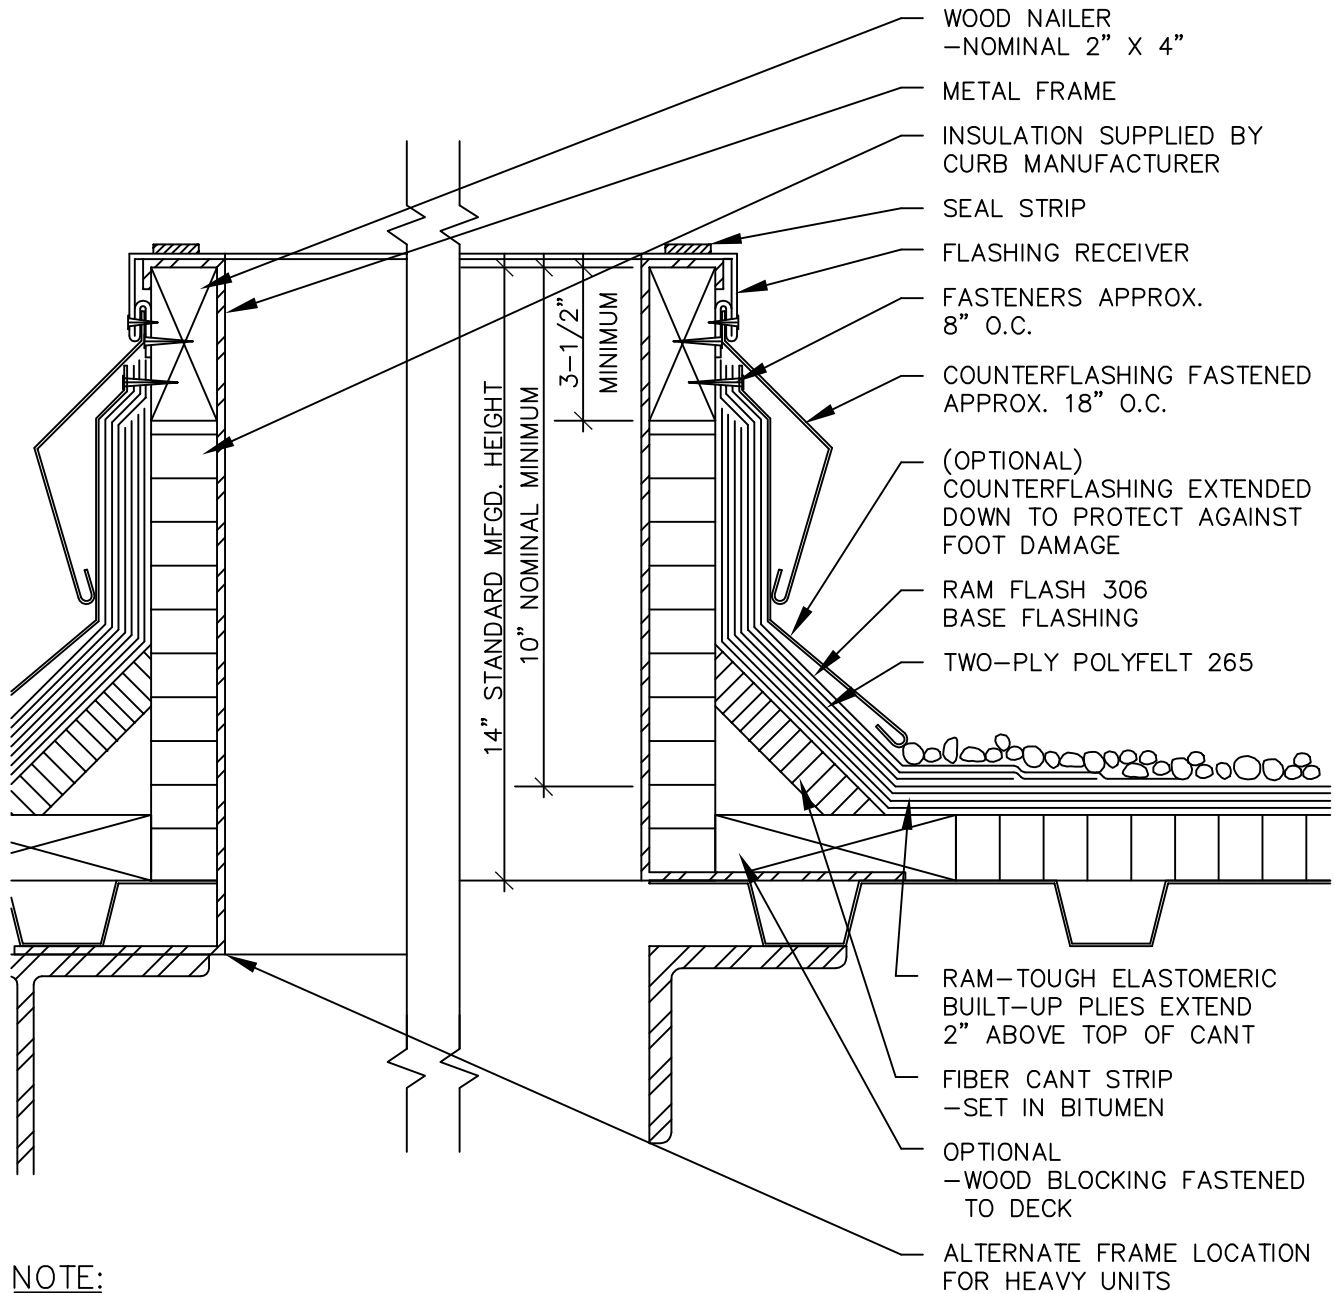

BARRETT COMPANY
BRT-ISEC.DWG
FOR TECHNICAL ASSISTANCE
CALL 1-800-647-0100